

1827

Town of Fairfield – Office of the Fire Marshal
140 Reef Road, Fairfield, CT 06824 Phone (203) 254-4720 Fax (203) 254-4724

Permit Application For
REMOVAL OR ABANDONMENT OF UNDERGROUND STORAGE TANKS

NOTE: This application to be filed with the Fire Marshal's Office BEFORE performing work.

- 1. Address of Removal or Abandonment: 54 Elm Street
- 2. Property Owner Name: Carolyn Barramone
- 3. Contractor's Name: Herbert Recovery Systems Phone: 1-800-500-TANK
- 4. Contractor's Address: Po Box 480 Middlebury Ridge, CT 06876
- 5. Connecticut Home Improvement Contractor's Registration, or Conn. D.E.P. Hazardous Waste Contractor's Registration, or Conn. Plumbing & Heating License # CT-HW-684
- 6. Number and sizes of tank(s) to be REMOVED 550 gal UST ABANDONED _____
- 7. Last contents of tank(s): #2 Heating Oil

***On rear of application or on separate sheet, show location of tank(s) to be removed/abandoned in relation to building and street.**

- 8. If tank is to be abandoned, indicate material tank is to be filled with: _____
- 9. Expected date work will commence: 8/24/21
Note: The Fire Marshal's Office does not routinely view removals of residential UST's.
- 10. Notify "Call Before You Dig" at 1-800-922-4455 *at least 72 hours before starting job.*
Permit Number: 20213302877

RECEIVED
AUG 30 2021
FAIRFIELD FMO

- 11. Removal or abandonment of underground petroleum tanks is regulated by the Connecticut Flammable and Combustible Liquids Code. This Code includes NFPA 30, sect. 2-4.4 which provides requirements on how to safely remove underground storage tanks which contained flammable or combustible liquids. *It is the responsibility of the applicant and/or the actual remover to adhere to these and any other applicable local, state or federal regulations.*
- 12. **If tank is leaking, notify D.E.P (860-424-3338) and the Fire Marshal (203-254-4720).**
- 13. Please supply this Office with copies of soil tests, remediation activities, and tank disposal receipts.
- 14. Applicant should contact the Fairfield Conservation Dept. prior to excavating.

Gary [Signature] Applicant's Signature 8/23/21 Date

Fire Marshal's Office Use Date Received: _____
Remarks: _____



Connecticut Department of
**ENERGY &
ENVIRONMENTAL
PROTECTION**

HAZARDOUS WASTE TRANSPORTER PERMIT SPILL CLEAN-UP CONTRACTOR PERMIT

Transporter Permit No.: CT-HW-684 **Expires on:** June 30, 2022
EPA ID No.: CTR000006049
Name of Permittee: HERBERT RECOVERY SYSTEMS INC P.O. BOX 480 – REDDING,
Mailing Address: CT 06876 GAGE HERBERT – 800-500-TANK (8265)
Facility Contact: gage@herbertrecovery.com

Wastes Authorized for Transport:

Connecticut Regulated Wastes- WASTE PCB'S, WASTE OIL, WASTE WATER SOLUBLE OIL, WASTE CHEMICAL LIQUID, WASTE CHEMICAL SOLID

Hazardous Waste - Per 40 CFR 261- ALL HAZARDOUS WASTE PER 40 CFR 261

The Permittee is authorized to transport hazardous waste and Connecticut regulated wastes in accordance with this Permit and the Regulations of Connecticut State Agencies Section 22-449(c)-103. The Permittee is also authorized to act as a contractor to contain, remove or otherwise mitigate the effects of the discharge, spillage, uncontrolled loss, seepage or filtration of any oil, petroleum or chemical liquids or solid, liquid or gaseous products or hazardous wastes pursuant to the requirements of Section 22a-454 of the Connecticut General Statutes.

March 4, 2021
Issuance Date

Yvonne Bolton
*Yvonne Bolton, Chief
Bureau of Materials Management &
Compliance Assurance*

Application Nos. 202101412 and 202101413

Received on: FEBRUARY 03, 2021

**PROOF OF PERMIT (A COPY OF THIS PAGE) SHALL BE MAINTAINED
IN THE VEHICLE DURING PERMITTED OPERATIONS**

1807

TOWN OF FAIRFIELD - OFFICE OF THE FIRE MARSHAL
140 Reef Road, Fairfield, CT 06430 Phone: (203) 254-4720 FAX: (203) 254-4724

PERMIT APPLICATION FOR

REMOVAL OR ABANDONMENT OF UNDERGROUND STORAGE TANKS

- 1. Address/Location: 54 Elm St. Fairfield, CT (Thurs. 10/5/00 - start 9 AM) 9:30 AM - inspection
- 2. Property Name: John Ritter
- 3. Applicant's Name: New England Energy Services
- 4. Applicant's Address: 154 Admiral St. Bridgeport, CT 06605

On rear of application, show location(s) of tank(s) to be removed/abandoned in relation to building and street.

5. If actual removal/abandonment is by a different company, give name, address & telephone number:

6. How many tanks will be 1 REMOVED ABANDONED
Last contents and size (s) of tank(s): 550

7. Who is to clean and purge tank(s): NEE

8. Indicate purging procedure to be used (ie: dry ice, steam, CO2 etc): Vac Truck

9. All tanks, regardless of size, product or method of cleaning or purging, shall be continuously monitored by a combustible gas indicator. Indicate make and model of combustible gas indicator: _____

10. For tank to be abandoned in place, indicate product tank is to be filled with: _____

11. The work area perimeter shall be secured at all times.

12. Notify the Fire Marshal's Office (254-4720) at least 48 hours in advance of removal.
(NOTE: Inspection may not be made of tanks less than 1,000 gal size).

13. Notify "Call Before You Dig" at 1-800-922-4455 at least 72 hours before starting job.
Permit Number: 20004001805

14. Supply Fire Marshal's Office with a certified report of any soil test taken.

15. It shall be the responsibility of the applicant and/or the actual remover to adhere to all applicable regulation of the State of Connecticut Department of Public Safety and of any other Local, State or Federal Agency. **IF TANK IS LEAKING, NOTIFY D.E.P. AT (860) 424 3338 AND FIRE MARSHAL (203) 254-4720. This application MUST be filed with the Fire Marshal's Office BEFORE performing work.**

Bart Liguori Applicant's Signature 9/27/00 Date

For Fire Marshal's Office Date Received: _____ By: _____
Site Visit? Y N Date: _____ By: _____

REMARKS: _____

TANK REMOVAL & REPLACEMENT - WORKSHEET

DATE: _____

ACCOUNT NO. 004550

NAME Biter

ADDRESS 54 Elm St.

TOWN Fairfield

TELEPHONE 255-4796

TANK LOCATION: in-ground

CELLAR ENTRANCE DIMENSIONS:

HEIGHT: _____ WIDTH: _____

BLOCKS YES _____ NO _____

ELECTRIC HAND TRUCK YES _____ NO _____

DELIVERY CELLAR HATCH _____ WALKIN _____

INSIDE DELIVERY _____

SLOPE _____ STEPS _____ LEVEL _____

OIL LINE FILTER _____ OIL LINE SIZE _____


DROP CLOTHS YES _____ NO _____

MATERIAL OR CONTROLS TO BE SUPPLIED BY
PLEASE LIST:

Needs to have a
licensed plumber on hand

COMMENTS: _____

DIAGRAM OF INSTALLATION

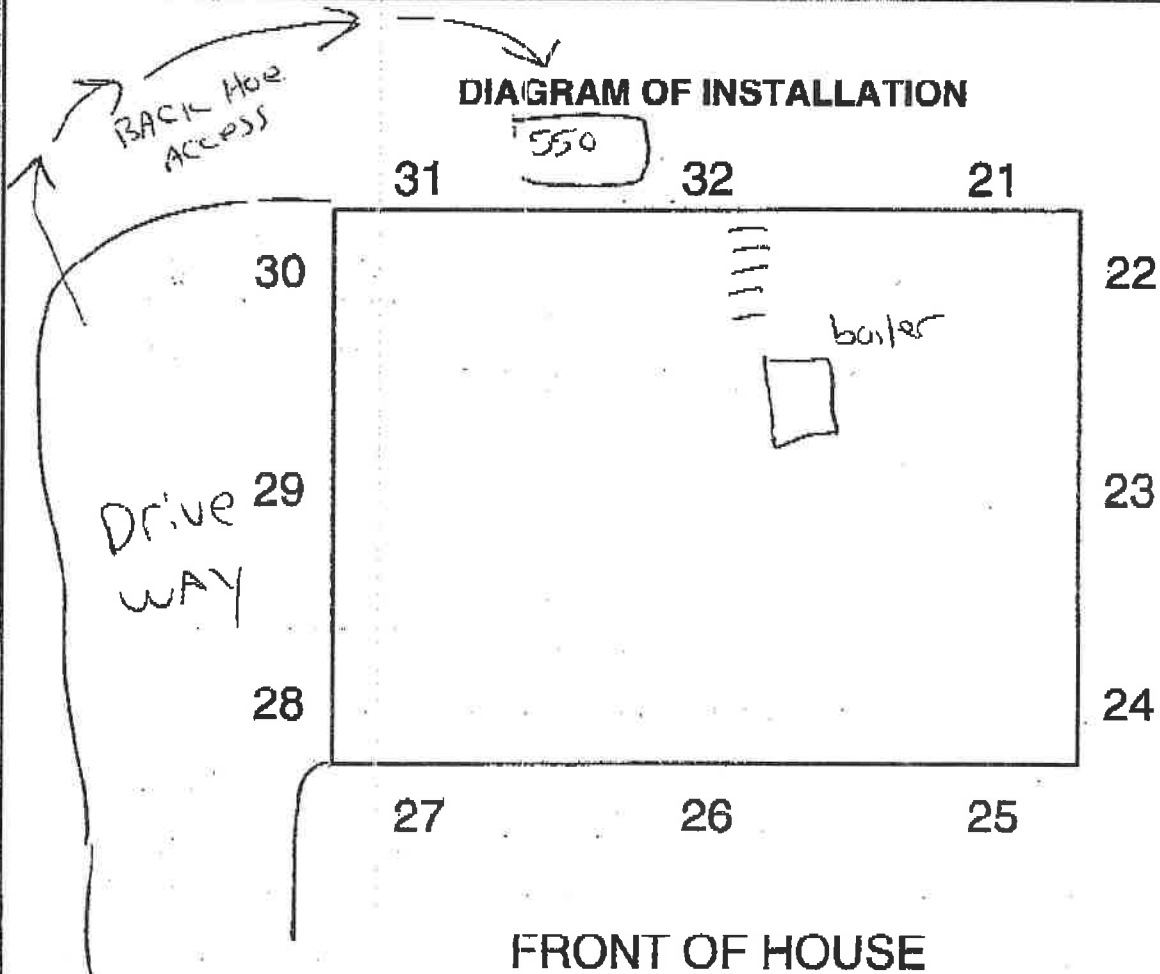



Santa Fuel, Inc.

154 Admiral Street P.O. Box 1141
Bridgeport, Connecticut 06601

Tel: 203-367-3661
Fax: 203-337-5198

www.santaenergy.com
CT License: S1 205179

October 6, 2000

Re: Tank Removal
John Ritter
54 Elm Street
Fairfield, CT 06430

Dear Mr. Ritter:

Please be advised that New England Energy Services has completed the removal of the 550 GALLON storage tank at the above location. The job was completed on October 5, 2000.

At the time of removal, approximately (TWO) Gallons of product was on the bottom of the oil tank and no visible signs of leaking product were detected. We contacted the inspector for the State of Connecticut Department of Environmental protection and the City Fire Marshals Office. All work was done according to State and Federal Regulations and the 550 GALLON oil tank was transported to a metal Recycling facility.

I am enclosing a copy of Brooks Laboratories Analysis Report in connection with the above location.

Sincerely,

Bart Liquigli
Tank Removal Specialist
New England Energy Services

BL/jh

Enclosure: Analysis Report

COPY - Fairfield Fire Marshal

▼ **BROOKS** ▼
LABORATORIES

▼
Environmental Scientists and Engineers
"Protecting People and the Environment"

ANALYSIS REPORT

Att: Bart

Client: NEW ENGLAND ENERGY

Address: 154 Admiral Street

PO Box 1141

Bridgeport, CT 06601

Phone: (800) 937-2682

Fax: (203) 331-0244 or 337-5198

Sample Collection: 10/05/00

Hygienist: Client

Lab. Number: 003064

Analysis: 10/05/00

Sampling Location: Ritter; 54 Elm Street, Fairfield, CT

PO# 30794, Acct # 004550

CERTIFICATE OF SOIL ANALYSIS
TOTAL PETROLEUM HYDROCARBONS

<u>Sample ID</u>	<u>Result, (ppm)</u>	<u>DEC**, (ppm)</u>
1 bottom	ND*	500/2500

Results are in parts per million (ppm).

*ND-Not Detected, < 25 ppm

**DEC-Direct Exposure Criteria, CTDEP Remediation Standard Regulations

Note: According to the State of Connecticut Department of Environmental Protection: The 500 ppm DEC pertains to residential areas or areas in which the ground water is used for drinking water. The 2500 ppm DEC refers to areas of long-term intense industrial or commercial development that, to the department's knowledge, are not used for drinking water.

Responsible party(ies) must notify the Connecticut DEP of any contamination over the DEC as described in Public Act 95-190. (Chemical Spills -24hr- 860-424-3338)

Method: EPA 418.1

I attest to the fact that this analysis was done according to the procedure mentioned above and with all care and precautions taken to make the results as accurate as possible.


Approved by

Note: If your results are above CTDEP DEC, additional analysis by Connecticut Method ETPH is recommended to confirm the identity of the suspected contaminant before proceeding with remediation.